



Witzlebenstr. 7 | 45472 Mülheim an der Ruhr, Germany
T +49 208 4952-0 | F +49 208 4952-264

Company / customer

Project description

Drawing number ID 100001979;EG-VA805526/112-0936/N

Commission

Manufacturer (company) Hans Turck GmbH & Co. KG

Path

Project name ID 100001979_V2

Make

TypePlace of installation

Responsible for project Hans Turck GmbH & Co. KG

Part feature

Manufacturer (company)

PathProtection class IP 66

Power supply

Supply line


Control voltageYear of manufacture

Created on 22.03.2019



Edit date	14.01.2021	by (short name)	Bast	Number of pages	12
-----------	------------	-----------------	------	-----------------	----

Parts list


SR. NO.	DEVICE TAG	QTY.	PART DESCRIPTION	MANUFACTURER	PART NUMBER	TYPE NUMBER
1	-CABINET_BASE	1	Cabinet (800 x 550 x 260)	ROSE Systemtechnik GmbH	ROSE.A17454-Unterteil	A17454-Unterteil
2	-CABINET_DOOR	1	Door with Window (800 x 550 x 260)	ROSE Systemtechnik GmbH	ROSE.A17454-Deckel	A17454-Deckel
3	-FLANGE_BREATHER	1	M20 Breather/Drainer with stainless steel castled nut	Redapt	RED.DP-E-4-0-04-S3	DP-E-4-0-04-S3
4	-FLANGE_GLAND_M20_BK	112	PU Gland Ex-e Blue M20	WISKA Hoppmann GmbH	WISKA.ESKE/1-i 20	ESKE/1-i 20
5	-FLANGE_GLAND_M25_BK	4	PU Gland Ex-e Black M25	WISKA Hoppmann GmbH	WISKA.ESKE/1-e 25	ESKE/1-e 25
6	-FLANGE_LEFT	1	Left Flange for ROSE cabinet 800x550x260	ROSE Systemtechnik GmbH	ROSE.FLANGE_80XX26_1X2_L_V2	FLANGE_80XX26_1X2_L_V2
7	-FLANGE_RIGHT	1	Right Flange for ROSE cabinet 800x550x260	ROSE Systemtechnik GmbH	ROSE.FLANGE_80XX26_1X2_R	FLANGE_80XX26_1X2_R
8	-MT	1	Remote I/O System excom® Module rack, non-Ex, for 24 modules	Hans Turck GmbH & Co KG	TUR.9100683	MT24-N
9	-MT_GW1	1	Sub-D Connector (for Non-Ex PROFIBUS devices)	Hans Turck GmbH & Co KG	TUR.6890942	D9T-RS485
10	-MT_GW2	1	Sub-D Connector (for Non-Ex PROFIBUS devices)	Hans Turck GmbH & Co KG	TUR.6890942	D9T-RS485
11	-OC1	1	Remote I/O System excom® PROFIBUS-DP fiber-optic coupler for zone 2	Hans Turck GmbH & Co KG	TUR.6890428	OC11Ex/3G.2
12	-OC1_BUS	1	Sub-D Connector (for Non-Ex PROFIBUS devices)	Hans Turck GmbH & Co KG	TUR.6890942	D9T-RS485
13	-OC2	1	Remote I/O System excom® PROFIBUS-DP fiber-optic coupler for zone 2	Hans Turck GmbH & Co KG	TUR.6890428	OC11Ex/3G.2
14	-OC2_BUS	1	Sub-D Connector (for Non-Ex PROFIBUS devices)	Hans Turck GmbH & Co KG	TUR.6890942	D9T-RS485
15	-PS1	1	Power supply, input: 1-phase, output: 24 V DC/5 A	Phoenix Contact	PXC.2320908	QUINT-PS/1AC/24DC/ 5/CO
16	-PS2	1	Power supply, input: 1-phase, output: 24 V DC/5 A	Phoenix Contact	PXC.2320908	QUINT-PS/1AC/24DC/ 5/CO
17	-X	7	End clamp	Phoenix Contact	PXC.3022276	CLIPFIX 35-5
18	-X1	2	Feed-through terminal block	Phoenix Contact	PXC.3044160	UT 10

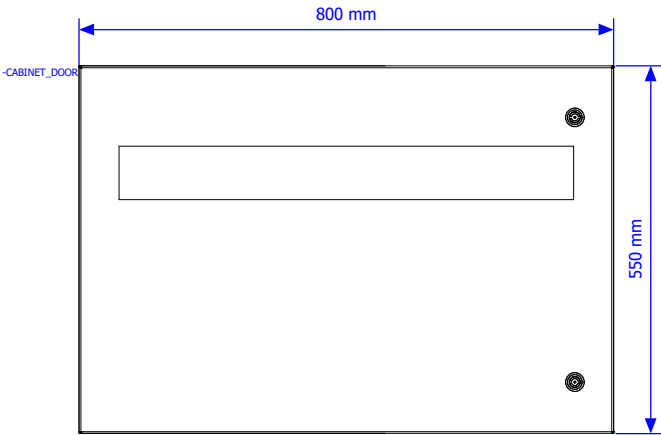


DOOR VIEW

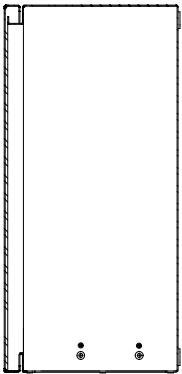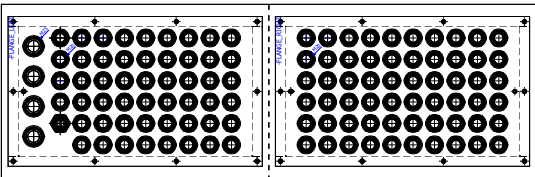

RIGHT VIEW

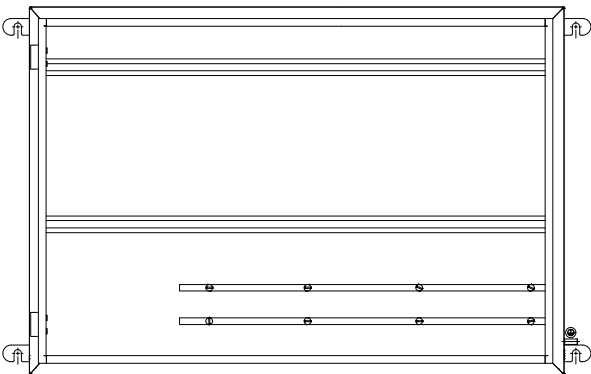

MOUNTING VIEW

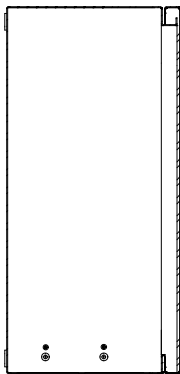

LEFT VIEW

