



Witzlebenstr. 7 | 45472 Mülheim an der Ruhr, Germany
T +49 208 4952-0 | F +49 208 4952-264

Company / customer

Project description

Drawing number ID 100004350;EG-VA805526/112-0620/3GD

Commission

Manufacturer (company) Hans Turck GmbH & Co. KG

Path

Project name ID 100014182_V2

Make

TypePlace of installation

Responsible for project Hans Turck GmbH & Co. KG

Part feature

Manufacturer (company)

PathProtection class

Power supply

Supply line

Control voltageYear of manufacture

Created on 04.12.2020

Edit date 14.01.2021 by (short name) Bast


Number of pages 9

INDEX



FACILITY	PAGE	PAGE DESCRIPTION	MODIFIED DATE	EDITED BY
+EXCOM_RIO				
	1	Cover Sheet	14.01.2021	
	2	Index	14.01.2021	
	3	Parts List	14.01.2021	
	4	GA	14.01.2021	
	5	GA Flange Plate	14.01.2021	
	6	GA Mounting	14.01.2021	
	7	Ground Wiring	14.01.2021	
	8	Incomer Supply Distribution	14.01.2021	
	9	MT PWR Wiring	14.01.2021	

Parts list


SR. NO.	DEVICE TAG	QTY.	PART DESCRIPTION	MANUFACTURER	PART NUMBER	TYPE NUMBER
1	-CABINET_BASE	1	Cabinet (800 x 550 x 260)	ROSE Systemtechnik GmbH	ROSE.A17454-Unterteil	A17454-Unterteil
2	-CABINET_DOOR	1	Door with Window (800 x 550 x 260)	ROSE Systemtechnik GmbH	ROSE.A17454-Deckel	A17454-Deckel
3	-FLANGE_BREATHER	1	M20 Breather/Drainer with stainless steel castled nut	Redapt	RED.DP-E-4-0-04-S3	DP-E-4-0-04-S3
4	-FLANGE_GLAND_M20_BU	112	PU Gland Ex-e Blue M20	WISKA Hoppmann GmbH	WISKA.ESKE/1-i 20	ESKE/1-i 20
5	-FLANGE_GLAND_M25_BK	4	PU Gland Ex-e Black M25	WISKA Hoppmann GmbH	WISKA.ESKE/1-e 25	ESKE/1-e 25
6	-FLANGE_LEFT	1	Left Flange for ROSE cabinet 800x550x260	ROSE Systemtechnik GmbH	ROSE.FLANGE_80XX26_1X1_L_V2	FLANGE_80XX26_1X1_L_V2
7	-FLANGE_RIGHT	1	Right Flange for ROSE cabinet 800x550x260	ROSE Systemtechnik GmbH	ROSE.FLANGE_80XX26_1X1_R	FLANGE_80XX26_1X1_R
8	-MT	1	Remote I/O System excom® Module rack, zone 2, for 24 modules	Hans Turck GmbH	TUR.9100682	MT24-3G
9	-PS1	1	Power supply, input: 1-phase, output: 24 V DC/5 A	Phoenix Contact	PXC.2320908	QUINT-PS/1AC/24DC/ 5/CO
10	-X	2	End clamp	Phoenix Contact	PXC.3022276	CLIPFIX 35-5
11	-X1	2	Feed-through terminal block	Phoenix Contact	PXC.3044160	UT 10
12	-X1	2	Feed-through terminal block	Phoenix Contact	PXC.3044188	UT 10 BU
13	-X1	2	Ground modular terminal block	Phoenix Contact	PXC.3044173	UT 10-PE
14	-X1	2	End clamp	Phoenix Contact	PXC.3022276	CLIPFIX 35-5

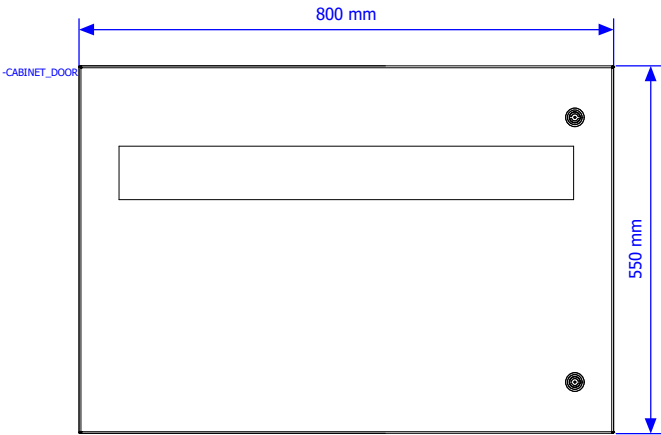


DOOR VIEW

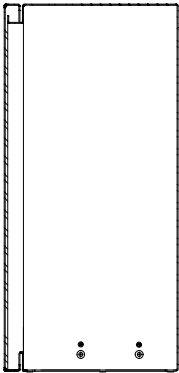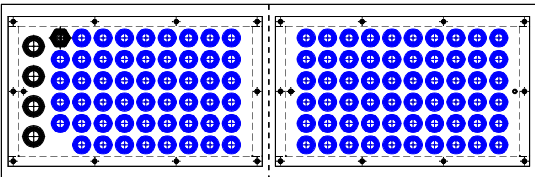


RIGHT VIEW

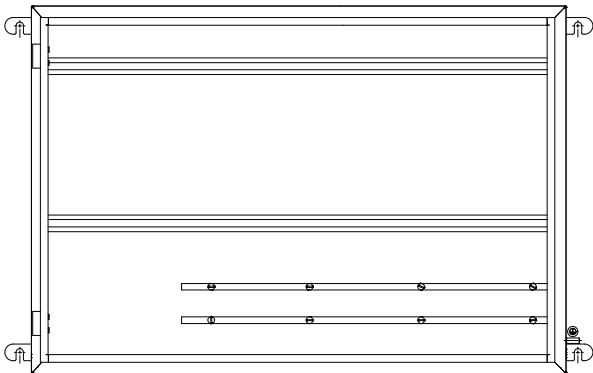

MOUNTING VIEW

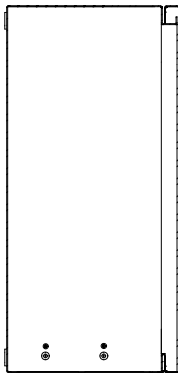

LEFT VIEW

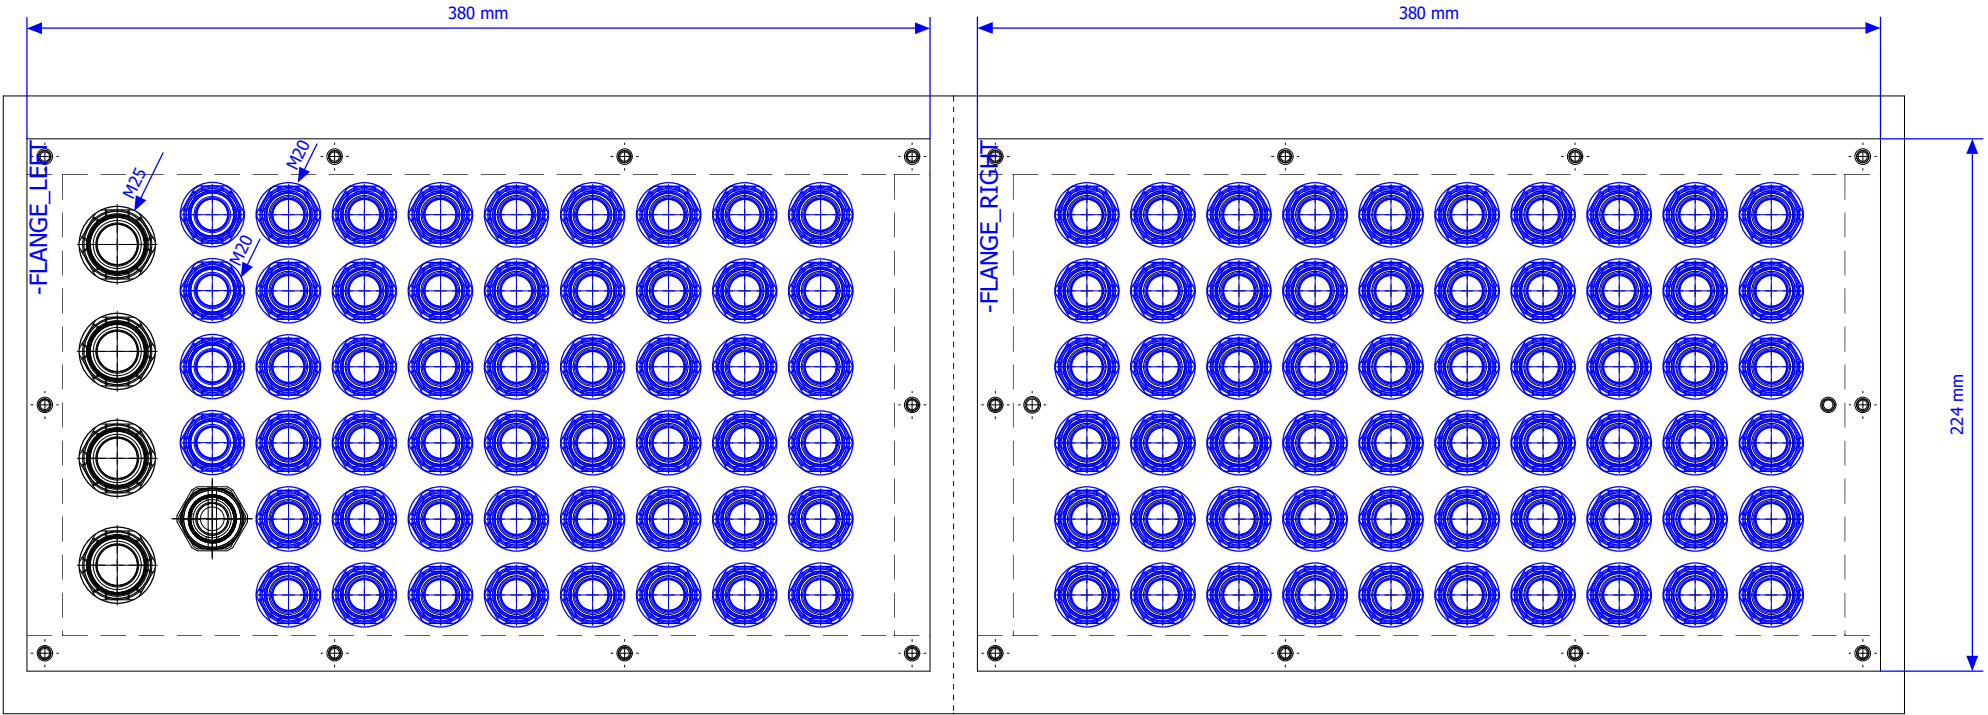



			Date	04.12.2020				Ground Wiring			=	
			Ed.	Bast							+ EXCOM_RIO	
			Appr								ID 100004350;EG-VAR05526/112-0620/3GD	
Modification	Date	Name	Original		Replacement of	Replaced by					Page	9

